

Levelized Cost of Electricity for Solar Photovoltaic and Electrical Energy Storage

Chun Sing Lai and Malcolm D. McCulloch

Energy and Power Group, Department of Engineering Science, University of Oxford, UK

Corresponding Author Email: chun.lai@eng.ox.ac.uk

Abstract-- With the increasing technological maturity and economies of scale for solar photovoltaic (PV) and electrical energy storage (EES), there is a potential for mass-scale deployment of both technologies in stand-alone and grid-connected power systems. The challenge arises in analyzing the economic projections on complex hybrid systems utilizing PV and EES. It is well known that PV power is of diurnal and stochastic nature, and surplus energy is generally available in midday during high irradiance levels. EES does not produce energy as it is not a conventional generator source. Commonly, the cost of a generating asset or the power system is evaluated by using Levelized Cost of Electricity (LCOE). In this paper, a new metric Levelized Cost of Delivery (LCOD) is proposed to calculate the LCOE for the EES. A review on definitions in LCOE for PV hybrid energy systems is provided. Four years of solar irradiance data from Johannesburg and the national load data from Kenya are obtained for case studies. The proposed cost calculation methods are evaluated with two types of EES (Vanadium redox-flow battery (VRB) and Lithium-ion (Li-ion) battery. It shows that the marginal LCOE and LCOD indices can be used to assist policymakers to consider the discount rate, the type of storage technology and sizing of components in a PV-EES hybrid system.

Index Terms-- PV, LCOE, Electrical Energy Storage

1. Introduction

As solar photovoltaic (PV) takes a larger share of generation capacity and where electrical systems cannot keep up with the increasing demand, increasing system flexibility should thus become a priority for policy and decision makers. Electrical energy storage (EES) could provide services and improvements to the power systems, so storage may one day be ubiquitous [1]. It is believed that energy storage will be a key asset in the evolving smart grid.

The use of energy storage is increasing as EES options become increasingly available and countries around the globe continue to enrich their portfolios of renewable energy. For example, increased deployment of EES in the distribution grid could make this process more effective and could improve system performance. Mainly, EES mediates between variable sources and variable loads; works by moving energy through time. Essentially, EES can smooth out this variability and allow electricity to be dispatched at a later time. EES are highly adaptable and can meet the needs of various users

including renewable energy generators, grid equipment, and end users [2]. Energy storage system may assist in achieving the aim to reduce emission reduction targets and lower the needs for PV output curtailments, which is a major issue with high penetration of PV [3].

Industrial and digital economy firms are collectively losing \$45.7 billion a year due to outages. These data suggest that across all business industries, the US economy is losing between \$104 billion to \$164 billion a year due to outages and another \$15 billion to \$24 billion due to poor power quality [4]. By using EES, the security of supply and power quality issue could potentially be minimized, and consequently with a reduction in outages.

There are many ways to calculate the economic viability of distributed generation and energy efficiency projects. The capital cost of equipment, the operation and maintenance costs, and the fuel costs must be combined in some ways so that a comparison may be made. One of the most commonly used metrics is the Levelized cost of electricity (LCOE).

In this paper, the concepts of marginal LCOE and Levelized cost of delivery (LCOD) are provided for a PV system with EES. Variable renewable generators such as solar PV are unlike conventional generators; they cannot be dispatched (except by curtailing output) and their output varies depending on local weather conditions, which are not well predictable. Existing papers have given reasons for deployment of EES in the future power system [5-7]. Many literatures analyzed the lifecycle or levelized cost solely for storage component, without considering the cost at a system level and energy exchange between generation source and storage [8-11]. LCOE analyses for renewable systems are also already well established and presented in many literatures, such as [12]. However, cost analysis for PV-EES system, and particularly for the analysis of levelized cost of storage has not been given a proper treatment and have not been clearly justified.

A detailed review on recent LCOE calculation methods for PV and EES systems has been given and possible shortcomings of existing methods have been highlighted. The marginal LCOE and LCOD have been derived from first principles. Real-life solar irradiance, load, and the most recent system components cost data from literatures have been collected for the analysis in

95 this paper. The results have been compared with
96 different sources to understand the implication of the
97 proposed methods.

98 The paper proceeds as follows, the definition of
99 LCOE will be reviewed in Section II. Section III will
100 provide a survey in the recent trend of large-scale PV
101 systems and the LCOE for renewable systems with
102 storage devices. Section IV provides the derivation for
103 the LCOD for EES and the $LCOE_{system}$, the LCOE for
104 the combined assets, PV and EES. Section V provides
105 the case studies for calculations of marginal LCOE and
106 LCOD. A real-life case study with the daily national load
107 data of Kenya and four years of collected solar irradiance
108 data from Johannesburg is given. Discussions and
109 conclusions are given in Section VI and Section VII
110 respectively.

111 2. Levelized cost of electricity for solar PV

112 LCOE is a measure of costs which attempts to
113 compare different methods of electricity generation on a
114 comparable basis. It is an economic assessment of the
115 average total cost to build and operate a power-
116 generating asset over its lifetime divided by the total
117 energy output of the asset over that lifetime. The LCOE
118 can also be regarded as the minimum cost at which
119 electricity must be sold in order to achieve break-even
120 over the lifetime of the project. The aim of LCOE is to
121 give comparison of different technologies (e.g., wind,
122 solar, natural gas) of unequal life spans, project size,
123 different capital cost, risk, return, and capacities.

124 The general equation for LCOE [13, 14] is given in
125 Equation (1). It is essentially the lifecycle cost of the
126 system be divided by the lifetime energy production of
127 the system.

$$128 \quad LCOE = \frac{\text{Lifecycle cost (\$)}}{\text{Lifetime energy production (kWh)}} \quad (1)$$

129 There are two methods commonly used to calculate
130 the levelized costs, known as the “discounting” method,
131 and the “annuitizing” method [15]. In the discounting
132 method shown in Equation (2), the stream of real future
133 costs and electrical outputs identified as C_t and E_t in
134 year t are discounted back with discount rate r , to a
135 present value (PrV). The PrV of costs is then divided by
136 the PrV of lifetime output. The levelized costs measured
137 under the “discounting” method, $LCOE_{Discount}$, is given
138 in Equation (2) below.

$$139 \quad LCOE_{Discount} = \frac{\text{PrV(Costs)}}{\text{PrV(Output)}} = \frac{\sum_{t=0}^n \frac{C_t}{(1+r)^t}}{\sum_{t=0}^n \frac{E_t}{(1+r)^t}} \quad (2)$$

140 In the “annuitizing” method as shown in Equation
141 (3), the present value of the stream of costs over the
142 device’s lifetime is calculated and then converted to an
143 equivalent annual cost, using a standard annuity formula.
144 This equivalent annual cost is then divided by the
145 average annual electrical output over the lifetime of the

146 plant, where n is the lifetime of the system in years.

$$147 \quad LCOE_{Annuitizing} = \frac{\text{Ann(Costs)}}{\text{Ave(Output)}} \\ 148 = \frac{\left(\sum_{t=0}^n \frac{C_t}{(1+r)^t} \right) \left(\frac{r}{1 - (1+r)^{-n}} \right)}{\left(\sum_{t=1}^n E_t \right) / n} \quad (3)$$

149 The two methods give the same levelized costs when
150 the discount rate used for discounting costs and energy
151 output in Equation (2) is the same as that used in
152 calculating the annuity factor in Equation (3). However,
153 for levelized costs to be the same under both measures,
154 annual energy output must also be constant over the
155 lifetime of the device. The annuity method converts the
156 costs to a constant flow over time. This is appropriate
157 where the flow of energy output is constant. It is
158 commonly assumed in the literature on levelized cost
159 estimates that annual energy output is constant. However,
160 the annual energy output of renewable technologies
161 would typically vary from day-to-day mainly due to
162 variations in the renewable resources. Therefore, it is
163 more appropriate to use the discounting method than the
164 annuitizing method when calculating LCOE for
165 renewable sources.

166 One of the misconceptions when calculating LCOE is
167 that the summation does not start from $t = 0$ to include
168 the project cost at the beginning of the first year [16].
169 The first year of the cost should not be discounted to
170 reflect the present value and there is no system energy
171 output to be degraded. Reference [16] has also provided
172 a review on the methodology of properly calculating the
173 LCOE for solar PV. The equation for calculating the
174 LCOE for a PV system is given in Equation (4) below:

$$175 \quad LCOE = \frac{\sum_{t=0}^n (I_t + O_t + M_t + F_t) / (1+r)^t}{\sum_{t=0}^n E_t / (1+r)^t} \\ 176 = \frac{\sum_{t=0}^n (I_t + O_t + M_t + F_t) / (1+r)^t}{\sum_{t=0}^n S_t (1-d)^t / (1+r)^t} \quad (4)$$

177 It is worth noting that the initial investment I_t is a
178 one-off payment. It should not be discounted and be
179 taken out of the summation. The LCOE for PV systems
180 given by the authors also considers the degradation
181 factor of PV modules. The energy generated in a given
182 year E_t is the rated energy output per year S_t multiplied
183 by the degradation factor $(1 - d)$ which decreases the
184 energy with time. The maintenance costs, operation costs
185 and interest expenditures for time year t are denoted as
186 M_t , O_t and F_t respectively.

187 LCOE has been employed as an objective function in
188 many analyses that deal with renewable-based off-grid
189 systems, and the value of lost load-related costs in LCOE
190 was studied in [17]. Reference [12] studied the time of
191 installment of PV system in the LCOE, whereas the
192 classic LCOE is static, i.e. the installment is done today,
193 the proposed methodology dynamically searches a point
194 in the future where LCOE would be optimum. The
195 papers have made a contribution to re-modify the usage

of LCOE, it is worth noting that the storage has not been considered in the system.

There are a number of reasons why large-scale PV system will be the future direction and in order to promote this, many researchers have considered different scenarios to achieve this. A comparative assessment of the three leading large-scale solar technologies in 2010 and 2020 for different locations is provided in [18]. Also mentioned in [19], it concludes that at present these technologies cannot yet compete with conventional forms of power generation, but will approach competitiveness around 2020 in favorable locations. In order to further refine policy recommendations, policymakers are in the need for more precise advice on which policy mixes are most workable to improve the usage of different technologies. Future research should assist policymakers in exploiting this potential by evaluating in more detail the needs for accompanying measures in the areas of storage and grid management. An economic analysis of the investment in grid-connected PV systems installed on the building's rooftops located in densely urbanized contexts is provided in [20]. The LCOE was calculated as an indicator of the competitiveness of the PV technology. Although the competitiveness of the PV LCOE with retail electricity prices is an appealing goal, the trajectory towards the grid parity is still slow in Italy.

A comparison of LCOE across PV systems with equal installation areas but with modules of different efficiencies installed with fixed tilt, 1-axis tracking or 2-axis tracking is provided in [21]. The first finding was that at a given module price in \$/W, more efficient PV modules lead to lower LCOE systems. The second finding was that when meeting a LCOE goal, the PV module efficiency has a lower limit that cannot be offset by module price; and the third and final finding was that both 1-axis and 2-axis tracking installations provide lower LCOEs than fixed tilt installations. To summarize, the LCOE will decrease with the increase in energy production of the system. The LCOE for PV systems in 143 countries is provided in [22]. The differences in both the solar resource and the financing cost were considered. The findings show that the LCOE values are highly dependent on the location, due to regional cost differences and variation of irradiance strength, which has a direct effect to the energy output [23].

The LCOE of commercial scale PV systems were investigated in [24, 25] with the System Advisor Model (SAM) developed by National Renewable Energy Laboratory. SAM [26] is a performance and financial model designed to facilitate decision making for people involved in the renewable energy industry. At present, SAM does not model isolated or off-grid power systems.

3. Review on cost benefit analysis for PV and energy storage system

3.1. PV system

An investigation on PV surplus generation and

storage requirements in Germany is provided in [5]. Surplus energies are generally low, but there are high surplus power peaks. It states that there are several questions remain for future research, in particular regarding the optimal mix of storage, curtailment and other flexibility options. The study of different energy storage technologies interaction with network expansion, power-to-heat, and thermal plants appears to be a particularly promising field of research. Additionally, the full system value of storage technologies should be investigated, including their capacity value and the provisions of ancillary services.

The benefits of deploying storage into a power network is provided in [6]. A simulation environment was developed with multiple types of network event to be monitored simultaneously. Historical data were used to recreate the network conditions with load flow analysis and an assessment was made with the participation of EES. The simulations have shown that operating an EES in the distribution network has a positive effect on the tasks of power flow management and voltage control. It is learnt that a higher power rating and energy capacity EES could solve a greater number of problems, but there is a balance of cost/benefit to be achieved. As progress is made in the transition to future electricity networks, electrical energy storage embedded at distribution level is set to become an integral part of the Smart Grid.

The techno-economic feasibility study of different PV hybrid systems for a typical household in Urumqi, China using the RETScreen is presented in [27]. The energy production and economical assessment for a grid-connected 5 MW PV power plant in Saudi Arabia were studied with RETScreen is provided in [28]. RETScreen [29] is a clean energy management software in the form of excel spreadsheet, with the purpose for calculating a large number of valuable financial indicators. The issue with the program is that the input solar isolation for the study does not include the daily load and renewable sources fluctuation into account, and the computation costs will be exponential for detail analysis due to the size of database.

The economic performance of a residential PV system in Queensland, Australia was investigated with the software package HOMER in [30]. It aimed to optimize the size and slope of PV array in the system. A PV-diesel hybrid system with battery backup for a village was studied with HOMER [31]. HOMER [32] is an optimization software package which simulates different renewable energy sources system layouts and sized them on the basis of net present cost. It uses sensitive analysis to consider different generation capacities and battery storage capacity to determine the optimal size of the system. The issue with this program is the high computational requirement, due to the large number of cases needed to be computed. As an example, the study in [30] required a total of 448,000 runs based on 28 sensitivities, where sensitivities are defined as the sizing control parameters such as size of PV and storage. In

addition, the software is of “Black Box” code utilization, where the optimization algorithm and cost calculating methodologies are unknown [33]. Reference [34] presents a method for technical-economic optimization of a PV system with energy storage. The system aims to meet the energy requirements of a given load distribution for a specific site. The storage unit characteristics and requirements were determined. The cost of storage has not been investigated.

A stand-alone PV system for electrification of a single residential household in the city of Faisalabad, Pakistan was studied in [35]. Lifecycle cost analysis was used to provide economic analysis of the system. It concluded that it is more economical to become an off-grid PV system than being grid-connected. It is noted that the cost of generation and storage sources were not separated and evaluated, where the electrical load requirement is used as the total system energy output. A simulation model was developed in [36] that studies the economics of EES for residential PV in Germany under eight different electricity price scenarios, in the years between 2013 to 2022. Investments in storage solutions were economically viable for small PV systems in 2013.

The LCOE for a system with PV, concentrate solar power plant and thermal energy storage on the Atacama Solar Platform is presented in [37]. The study uses monthly solar irradiance to calculate the annual energy production from PV system. Reference [38] presents a technical and economic model for the design of a grid-connected PV plant with EES. The aim is to determine the PV system rated power and the EES capacity being able to minimize the LCOE. In the study, total energy demand was used for cost analysis instead of the energy output from the generation assets. Reference [39] presents the LCOE study of renewable energy in China with an emphasis on feed-in-tariffs and discount rates. Energy storage was not considered in the study.

The modification to the electric power system required to incorporate high penetration of variable wind and solar electricity generation in a transmission constrained grid is presented in [7]. The main concerns with combining the use of these sources at large-scale are the restricted flexibility of thermal generators to reduce output, in addition with the relative short time coincidence of the renewable resource with the instantaneous electricity demand. This would result in unusable renewable generation and increased system direct and opportunity costs. A highly flexible system, with must-run base-load generators virtually eliminated, allows for penetrations of up to about 50% variable generation with curtailment rates of less than 10%. For renewable penetration levels up to 80%, keeping curtailments to less than 10% requires the use of load shifting and storage capacity with the size equal to approximately one day of average demand.

It is impractical to install an EES that is capable of providing a solution to all events at all times; either the events would have to be very modest and the EES will be very large. The EES operates to make a contribution to improve network performance in cooperation with

other Smart Grid control actions such as active generator curtailment or demand side management. The contribution significance made by EES depends upon the event schedule and the dynamic behavior of the network on both short and long-term time-scale.

Reference [40] suggested that energy storage and generation must be separated. There is an increasing acceptance that energy storage will play a major role in future electricity systems to provide at least a partial replacement for the flexibility naturally present in fossil-fueled generating stations. It mentioned that if all UK power come from PV with storage, 57.1% of all energy consumed would have passed through storage. As a result, if future electricity systems are powered largely from inflexible sources, substantial fractions of all electrical energy consumed may pass through storage.

An overview of the Spanish power generation sector is given in [41]. The sector is surrounded with number of challenges, with generation overcapacity as one of the factors [42]. Appropriate energy planning could have reduced investments in the Spanish power sector by 28.6 billion euro by 2010, without the conflict on performance in terms of energy security or sustainability. The main causes of these surplus investments were partly due to solar technologies. EES could potentially improve the situation by reducing the required generation capacity by providing flexibility to the system.

3.2. Electrical energy storage

Turning to EES, a cost analysis for various EES in grid-connected system is presented in [8]. It calculates the cost of electricity added by storing electricity for different storage technologies. It has made comparisons solely for storage technologies and renewable energy system which have not been considered in the paper. The economic implications of EES technologies are obscured for the power grid stakeholders [9]. If the cost of charging electricity would be deducted from the LCOE delivered by EES, the net Levelized cost of storage (LCOS) is presented in Equation (5) [9].

$$LCOS = LCOE - \frac{\text{price of charging power}}{\text{overall efficiency}} \quad (5)$$

Equation (5) states that LCOS will be less than LCOE. The cost of storage should be higher than the cost of the system, since the storage cost needs to include the cost of electricity generation to be stored in EES. The storage will have an efficiency factor; hence the storage output energy will be lower than the energy generates by source. It is noted that the generation source in the calculation of LCOS or LCOE for the system has not been considered. The energy stored in storage system is affected by the energy production of renewable source.

In general, the future perspective is promising for Lithium-ion (Li-ion) batteries in power system applications as the retail price is declining and the technical specifications are reaching new heights with

reducing manufacturing costs, extending the lifetime, using new materials, and improving the safety parameters. Li-ion and lead-acid batteries are suitable for short duration services, whereas Sodium-sulfur and vanadium redox-flow batteries (VRB) are suitable for long duration services [10].

A study of the LCOE for hydrogen-bromine flow battery is provided in [11]. It mentioned that although the capital cost of storage is of critical, the most important metric is the levelized cost of electricity and it should be the value to be minimized, rather than minimizing capital cost. At 0.40 \$/kWh, the hydrogen-bromine flow battery system is too expensive for grid-level application. It is explained that the high cost is due to hydrogen storage. The costs of the hydrogen-bromine system can be significantly lowered if the costs of the battery stack and power electronics can be reduced.

Li-ion batteries are the most common storage technology and the VRB are emerging as another storage option for grid applications [43]. The World Energy Council [44] has proposed a formula as shown in Equation (6), known as the Levelized Cost of Storage. It enables the comparisons between different types of storage technologies in terms of average cost per produced and stored kWh.

$$LCOS = \frac{I_0 + \sum_{t=1}^n \frac{C_{EES_t}}{(1+r)^t}}{\sum_{t=1}^n \frac{E_{EES_t}}{(1+r)^t}} \quad (6)$$

I_0 is the initial investment cost. C_{EES_t} and E_{EES_t} are the total costs and energy output at year t respectively. It is mentioned that the LCOS formula only summarizes the general LCOS of each technology, i.e. without applying the application cases to a specific context such as for a PV system. It shows that the renewables industry faces two main challenges when applying the LCOS metric:

1. Arbitrariness: The application case varies widely and dependent on the type of service provide;
2. Incompleteness: The cost calculation does not reflect the characteristics of storage. Traditionally, LCOE is reflected on by the applied discount factor. Since it neglects higher potential revenues, e.g., from providing flexibility, it is a simplified approach for the actual value of storage.

Policymakers should examine storage through holistic case studies in context, rather than only emphasis in generic cost estimations. Lazard [45] modeled 10 different use cases for storage including frequency regulation, grid balancing and micro-grid support with the possibility of eight different storage technologies, ranging from compressed-air energy storage to Li-ion batteries. The required energy output for different storage applications are predetermined. Because of the operating and physical conditions, some electrical energy storages would need to be overrated. This oversizing results in depth of discharge (DOD) over a

single cycle less than 100%. While energy storage is a beneficiary of and sensitive to various tax subsidies, the report presents the LCOS on an unsubsidized basis in order to isolate and compare the technological and operational components of energy storage systems and use cases.

The LCOS provided by Lazard is an optimistic estimation and in practice, the storage system will not be used to 100% of its capacity. In the case of PV integration, the energy stored in the storage system depends on the PV system output and this is highly arbitrary as it depends on the nature of solar irradiance. Therefore, the LCOS will be different in real-life situation and is expected to be higher. The values provided by Lazard can be used as a comparison for different storage technologies and applications, but cannot be used for system resource planning and decision making. The operational parameters used in Lazard's LCOS study for PV integration are presented in Table 1.

Table 1

Parameters used for LCOS study for PV integration [45].

Parameters	
Project lifetime (Year)	20
Discount rate (%)	8
Storage power capacity (MW)	2
Storage energy capacity (MWh)	4
Cycles per day (100% DOD)	1.25
Days of operation per year	350
Annual energy production (MWh)	1750
System's total generated energy (GWh)	35

504

The report did not provide the method for the LCOS calculation. It is assumed that the results are calculated with Equation (6). The results of LCOS for PV integration with the lower and upper bound range for different storage technology are provided in Table 2. The results from Table 2 will be useful to provide a comparison of the results in the case study in this paper. Table 3 presents a comparison on the levelized cost analysis features for the three prominent hybrid renewable energy system software packages. It is learnt that LCOS are currently not included at present.

Table 2

Current LCOS for PV integration [45].

Storage Type	LCOS (\$/kWh)	
	Lower bound	Upper bound
Zinc	0.245	0.345
VRB	0.373	0.950
Li-ion	0.355	0.686
Lead	0.402	1.068
Sodium	0.379	0.957

519

A new methodology for the calculation of levelized cost of stored energy was proposed in [46]. New terms have been proposed such as price increase factor and internal transfer cost to calculate the LCOE of the hybrid system. These two terms are currently not well defined in the industry and no literature has discussed them, hence these values are not practical to use for

526

Table 3

Comparison of levelized cost analysis features for the prominent hybrid renewable energy system software packages.

	HOMER Pro	RETScreen Expert	System Advisor Model (SAM)
Developer	HOMER Energy LLC	Natural Resources Canada	National Renewable Energy Laboratory
Availability	Priced	Free	Free
Description	The software can provide hourly interval data analysis, hence better modelling of the intermittency of renewables. It is capable of performing brute-force system optimization such as for components sizing purposes. The software may generate synthetic hourly solar data from monthly average clearness index or daily radiation data if real-data is unavailable.	The software evaluates the performance of systems based on statistical monthly average data. One of the major advantages of the software is that it has an abundant amount of geographical data built-in, which is obtained from NASA's climate database.	The software is used for studying grid-connected systems only, and currently does not support stand-alone system analysis. Shading and snow data can be included in the analysis to model the reduced PV output. A database of hourly solar irradiance data is provided from NREL database.
Supported energy storage model	Flywheel, customizable batteries, flow batteries and hydrogen	Thermal storage tank	Lead-acid and Li-ion
Provide LCOE?	Yes	No	Yes
Provide LCOS?	No	No	No
Reference	[49]	[50]	[51, 52]

calculations. As stated in [47], the economic estimation on hybrid systems utilizing a combination of PV, EES and cogeneration is difficult and at present, no comprehensive method exists for guiding decision makers. The proposed LCOE for the hybrid system is given in Equation (7) [47]:

$$\text{LCOE} = \frac{I + \sum_{t=1}^n \frac{(I * i + O + F_{\text{chp}})}{(1+r)^t}}{\sum_{t=1}^n E_{\text{tpv}}(1-d_1)^t + \frac{E_{\text{tchp}}(1-d_2)^t}{(1+r)^t}} \quad (7)$$

I is the total installation cost which includes the cost of PV, battery and the combined heat and power (CHP) module, i is the interest rate on the hybrid system for 100% debt financing. O is the total operation and maintenance cost. F_{chp} is the annual fuel cost of the CHP unit. E_{tpv} and E_{tchp} are the rated annual energy production from PV and CHP unit respectively. d_1 and d_2 are the degradation rates for PV and CHP unit respectively. The energy produced by PV system is not discounted. It does not reflect the actual value of the PV energy in the future. The equation for the hybrid system LCOE does not discount the energy lost from using the storage system due to round-trip efficiency, where the total energy output from the system is the energy produced by PV and the CHP unit.

Reference [48] has discussed and proposed the LCOE metric for energy storage. The authors claimed that large-scale storage is becoming a significant issue for utilities, therefore it justifies the development of a levelized costing algorithm which accommodates storage systems. In the LCOE equation for energy storage, the energy output from the energy storage is assumed to be the annual energy production of the system. This may not be the case as not all energy produced by the system will be delivered by energy storage.

4. Cost calculation methodology

The literature review has shown that many LCOE work considers the cost of storage and renewable energy systems as a whole rather than being separated. Also, it is learnt that the daily average global solar irradiance or capacity factor are commonly used to calculate the total energy generation from the hybrid system. This will provide a less accurate study due to the absence in the consideration of variability of renewable sources. This section aims to provide the methodology to better represent the LCOE for a PV-EES hybrid system.

It is common to store the excess energy generated by PV in storage systems to be used later on. The PV energy at an available time instance should be used directly to support the load and to avoid the losses due to round-trip efficiency, η . In splitting the total energy produced by the PV system into two types, known as the surplus and the direct energy. Surplus energy, $E_{\text{pvsurplus}}$, is the extra energy generated by PV system and not consumed by the load. Direct energy, E_{pvdirect} , is the energy that consumed by the load directly. $C_{\text{pvsurplus}}$ and C_{pvdirect} are the costs for generate surplus energy and direct energy respectively.

Equation (8) gives the LCOE for a PV system which has both the direct and surplus energy component. The surplus energy can be stored in EES. To fully utilize the PV energy, since the surplus energy cannot be used when load demand is less than the generation output, therefore there is a need to have energy storage to store the energy. It is noted that the energy delivered by EES will be reduced due to the round-trip efficiency. LCOE_{PV} will be reduced when storage is included in the system by utilizing the surplus energy.

As energy storage is not an energy generating source, however, in the definition of LCOE, it is defined that only energy generation is considered [53]. As a result, the definition of LCOE for PV system with EES needs

further consideration in order to provide a more accurate representation of the LCOE. Equations (9) shows the LCOE with two partitions, namely, direct and surplus energy from the conventional LCOE as shown in Equation (4).

$$LCOE_{PV} = \frac{\sum_{t=0}^n \frac{(C_{pvsurplus} + C_{pvdirect})_t}{(1+r)^t}}{\sum_{t=0}^n \frac{(E_{pvsurplus} + E_{pvdirect})_t}{(1+r)^t}} \quad (8)$$

$$LCOE_{PV} = \frac{\sum_{t=0}^n \frac{C_{pvsurplus}_t}{(1+r)^t}}{\sum_{t=0}^n \frac{(E_{pvsurplus} + E_{pvdirect})_t}{(1+r)^t}} + \frac{\sum_{t=0}^n \frac{C_{pvdirect}_t}{(1+r)^t}}{\sum_{t=0}^n \frac{(E_{pvsurplus} + E_{pvdirect})_t}{(1+r)^t}} \quad (9)$$

Figure 1 shows the energy flow diagram of the renewable energy and storage system. The PV array in the system are separated into two sets. The net energy output of the EES needs to take account of η . The EES experiences the electrical energy flowing in and flowing out.

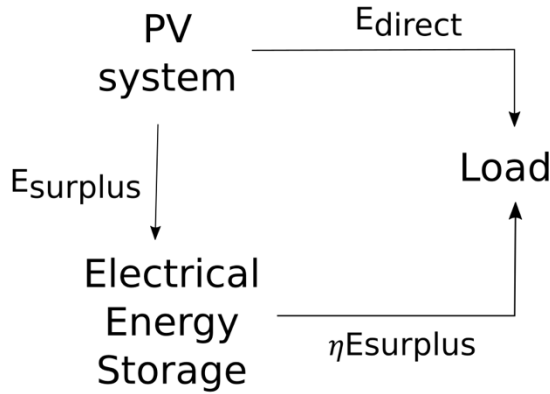


Figure 1: Energy flow diagram of the PV system

To simplify the derivation process, Equations (10) to (14) are used for the LCOE calculations in the upcoming derivations.

$$C_{EES} = C_{Cap_EES} + \sum_{t=0}^n \frac{C_{O\&M_EES}_t}{(1+r)^t} \quad (10)$$

$$E_{EES} = \eta \sum_{t=0}^n \frac{E_{surplus}_t (1 - D_{EES})^t}{(1+r)^t} \quad (11)$$

$$C_{pvsurplus} = (C_{Cap_{pv}} + C_{Inst_{pv}}) N_{surplus_ave} + \sum_{t=0}^n \frac{\sum_h^m C_{O\&M_pv} N_{surplus_h}}{(1+r)^t} \quad (12)$$

$$C_{pvdirect} = (C_{Cap_{pv}} + C_{Inst_{pv}}) N_{direct_ave} + \sum_{t=0}^n \frac{\sum_h^m C_{O\&M_pv} N_{direct_h}}{(1+r)^t} \quad (13)$$

$$E_{pvdirect} = \sum_{t=0}^n \frac{E_{direct}_t (1 - D_{pv})^t}{(1+r)^t} \quad (14)$$

D_{EES} and D_{pv} are the annual performance degradation rates for storage and the PV array respectively. N_{direct_ave} and $N_{surplus_ave}$ are the fraction of PV array for generating energy for direct consumption and surplus energy for storage respectively. N_{direct_h} and $N_{surplus_h}$ are the fraction of PV array at hour h for generating energy for direct consumption and surplus energy for storage respectively. E_{direct} is the energy generated from PV and directly supplied to the load without going through storage. $C_{pvsurplus}$ and $C_{pvdirect}$ are the total lifetime costs of PV generation that produce the surplus and direct consumption of energy for the system respectively.

4.1. Electrical energy storage

The derivation of the LCOE for the EES is given in Equations (15) to (18). The LCOE of the energy into the system is given in Equation (15).

$$LCOE(E_{in}) = \frac{\sum_{t=0}^n \frac{C_{int}_t}{(1+r)^t}}{\sum_{t=0}^n \frac{E_{int}_t}{(1+r)^t}} \quad (15)$$

C_{int}_t is the total cost for delivering the PV energy into EES at year t . E_{int}_t is the input energy to the EES at year t . The LCOE for EES in a renewable energy system is more complicated to comprehend. It is necessary to take the cost of the solar array to generate the surplus energy to be stored into the EES into account. This is due to the fact the energy stored in the EES is produced by the solar array. The LCOE of the energy delivered by the EES is given in Equations (16) and (18):

$$LCOE(E_{out}) = \frac{\sum_{t=0}^n \frac{C_{int}_t}{(1+r)^t} + \sum_{t=0}^n \frac{C_{storage}_t}{(1+r)^t}}{\eta \sum_{t=0}^n \frac{E_{int}_t}{(1+r)^t}} \quad (16)$$

$$LCOE(E_{out}) = \frac{\sum_{t=0}^n \frac{C_{int}_t}{(1+r)^t}}{\eta \sum_{t=0}^n \frac{E_{int}_t}{(1+r)^t}} + \frac{\sum_{t=0}^n \frac{C_{storage}_t}{(1+r)^t}}{\eta \sum_{t=0}^n \frac{E_{int}_t}{(1+r)^t}} \quad (17)$$

$$LCOE(E_{out}) = \frac{C_{pvsurplus}}{\eta E_{pvdirect}} + \frac{C_{EES}}{E_{EES}} \quad (18)$$

By splitting Equation (11) into two individual components, the final form of the LCOE for the EES is given in Equation (19).

$$LCOE(E_{out}) = LCOE_{in} = \frac{1}{\eta} LCOE(E_{surplus}) + LCOE_{out} \quad (19)$$

In practice, E_{in} will be the surplus energy, $E_{surplus}$ flowing into the storage to be a dispatchable source of power. Therefore, C_{in} will be $C_{PVsurplus}$, the fraction of PV array that produced the surplus energy for the system. The surplus energy may be generated in some hours of a day by the same panels producing directly-used energy in some other hours. Therefore, a panel can produce both excess and direct electricity, depending on time of the day, and/or seasonal conditions. As proposed in Equation (16), the cost of the electricity delivered by storage needs to take into account of the fraction of solar array for producing the surplus energy. To calculate the fixed costs (capital and installation costs) for the PV system, the fraction of PV arrays generates the surplus and direct energy needs to be fixed. The operation and maintenance costs varies throughout the lifetime of the system. Equations (20) and (21) present the average of fraction for direct and surplus energy respectively for the PV array. The fractions of array for direct and surplus energy at a particular time instance h is presented in Equations (22) and (23) respectively. The fractions of array should make up the PV array for the system, N_{Total} , in the PV system as given in Equations (24) and (25).

$$N_{direct_ave} = \frac{\int_{h=0}^m P_{direct}(h)}{\sigma \int_{h=0}^m \varepsilon(h)} \quad (20)$$

$$N_{surplus_ave} = \frac{\int_{h=0}^m P_{surplus}(h)}{\sigma \int_{h=0}^m \varepsilon(h)} \quad (21)$$

$$N_{direct_h} = \frac{P_{direct}(h)}{\sigma \varepsilon(h)} \quad (22)$$

$$N_{surplus_h} = \frac{P_{surplus}(h)}{\sigma \varepsilon(h)} \quad (23)$$

$$N_{Total} = N_{direct_ave} + N_{surplus_ave} \quad (24)$$

$$N_{Total} = N_{direct_h} + N_{surplus_h} \quad (25)$$

σ is the PV array efficiency, ε is the solar irradiance at Wm^{-2} , h is the time interval of the system operation. When solar irradiance is zero, then there will be zero power output, that is $P_{surplus}$ is also zero. The situation will be 0/0, that is mathematically, it is an undefined solution. However, in real-life situation, these cases should not be taken into account but rather just in considering the situation when there is a PV output. Therefore, the authors limit the study to cases in which $P_{surplus}$ or P_{direct} is not zero. There will be situations such that there is a P_{direct} but no $P_{surplus}$ as the generated power is fully supplied to the load fully.

4.2. Solar PV and storage system

For the PV and EES storage system, the following LCOE relationship will hold:

$$LCOE_{system} = \frac{\sum_{t=0}^n \frac{C_{system_t}}{(1+r)^t}}{\sum_{t=0}^n \frac{E_{system_t}}{(1+r)^t}} \quad (26)$$

C_{system_t} and E_{system_t} are the total cost and total energy production from the system at time t respectively. The total cost of the renewable system is the sum of PV generation and storage costs. The total energy produced by the system is the energy output of EES and the energy directly delivered to the load by PV. In this paper, the term $LCOE_{system}$ is denoted for the LCOE for the generating and energy delivering assets PV and EES system. It does not consider the context of standalone or on-grid system. The purpose of $LCOE_{system}$ is to provide the understanding of the cost implications to the renewable and storage assets. Therefore, the LCOE for the system is given in Equation (27).

$$LCOE_{system} = \frac{C_{pvsurplus} + C_{EES} + C_{pvdirect}}{E_{EES} + E_{pvdirect}} \quad (27)$$

5. Case studies

5.1. Data acquisition

Solar irradiance and load data were obtained for the studies in this paper. The SKS 1110 pyranometer device manufactured by Skye Instruments [54] was used to collect the irradiance data. Four years of complete solar irradiance data in 2009-2012 were collected in Johannesburg. The sampling rate is at a sample/30min. Due to the restricted space to present the hourly annual solar irradiance, Figure 2 shows the solar irradiance collected for the first six days in 2009-2011.

The national load curve of Kenya is presented in Figure 3. As explained in [55], the national peak starts rising at 18:30 and reaches its peak at 20:30. The shape of the national load profile for South Africa and Kenya are very similar [56, 57]. It is therefore safe to have the assumption that the load curve for Johannesburg is similar to that for Kenya.

PV projects are currently favorable in Kenya. Kenya has an abundant source of solar irradiance and it is capable to generate several times more electricity from PV than the national grid annual consumption. The economic value of PV has already exceeded the potential projects costs in 2012 [58] and grid-connected PV systems may already be more economical than the most expensive conventional power plants, such as gas turbines and medium-speed diesel generators. They are currently the largest share of Kenya's current power generation mix [59].

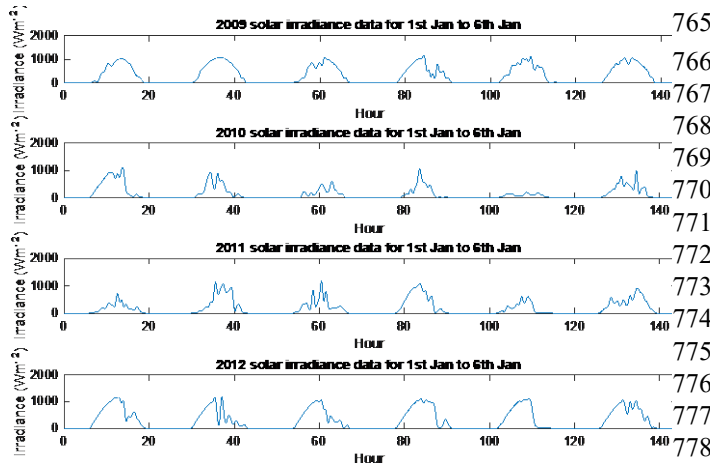


Figure 2: Solar irradiance between 1st Jan to 6th Jan for 2009-2012

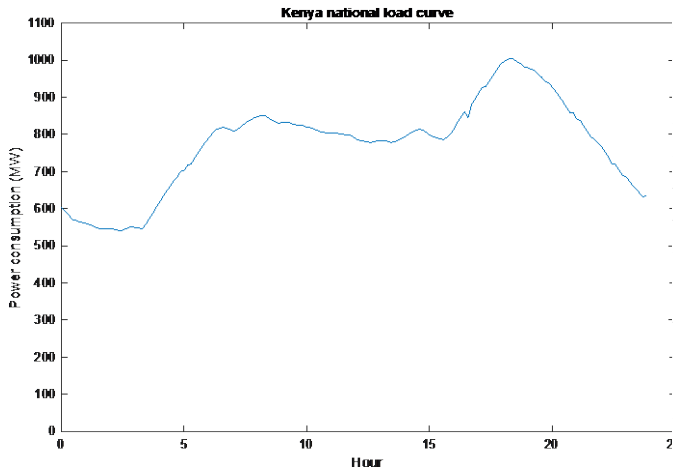


Figure 3: Daily national load curve in Kenya

5.2. Cost and asset specification

The cost and asset specification is presented in Table 4. The solar panel to be used for the system is the Sharp ND-250QCS. It has an efficiency of 15.3% and has a rated power of 250 W [60]. The lifetime of PV panels can be up to 25 years [61], which exceeds the lifetime of EES. In the case studies, the lifetime of PV panels is assumed to be the same as the storage system and the project lifetime.

Table 4

Cost and technical specification of the system components for case study.

		EES	
		PV	Li-ion battery
Capital cost (C_{cap})	120 (\$/unit) [60, 62]	760-1600 (\$/kWh) [45, 63]	715-1640 (\$/kWh) [45, 63]
Installation cost (C_{inst})	108 (\$/unit) [60]	N/A	N/A
O&M cost ($C_{O\&M}$)	6 (\$/unit/year) [60]	100-140 (\$/kWh) [63]	80-95 (\$/kWh) [63]
System Lifetime (n)	N/A	20 years [45, 63]	15 years [45, 63]
Round-trip efficiency (η)	N/A	70% [45, 63]	90% [10, 45, 63]
Degradation rate	0.5 %/year [64, 65]	0.01 %/year [46]	2 %/year [46]

5.3. Marginal levelized cost of electricity

The concept of marginal LCOE is proposed in this paper. By definition, marginal cost is the cost of producing one more unit of output. In this paper, the authors proposed the marginal LCOE to examine the long-term investment by adding additional PV capacity and storage into the system. This will be useful to understand the costs implication with respect to the system investment.

In this paper, three different cases of the marginal LCOE are studied with the following assumptions.

Case 1: The peak of solar power meets the peak load demand with no surplus energy available;

Case 2: Extra PV capacity is added to the system and additional solar power will be generated. However, the surplus energy will be discarded because of no storage;

Case 3: Storage will be used to store the surplus energy. The size of PV capacity is the same as that in Case 2.

To provide the visual illustration for the concepts of marginal LCOE, a constant linear load curve and clear sky irradiance are used as shown in Figures 4 to 6. The total cost and energy to calculate the LCOE for the system in the case studies are given in Equations (28) and (29), with $C_{case(k)}$ is the annual cost for the PV array and $E_{pv(k)}$ is the annual energy production from the PV array in case k.

$$C_{total_case(k)} = \sum_{t=0}^n \frac{C_{case(k)_t}}{(1+r)^t} \quad (28)$$

$$E_{total_case(k)} = \sum_{t=0}^n \frac{E_{pv(k)_t}}{(1+r)^t} \quad (29)$$

In Case 1, the load uses all the produced solar energy. LCOE is then calculated. Figure 4 shows the visual representation of Case 1.

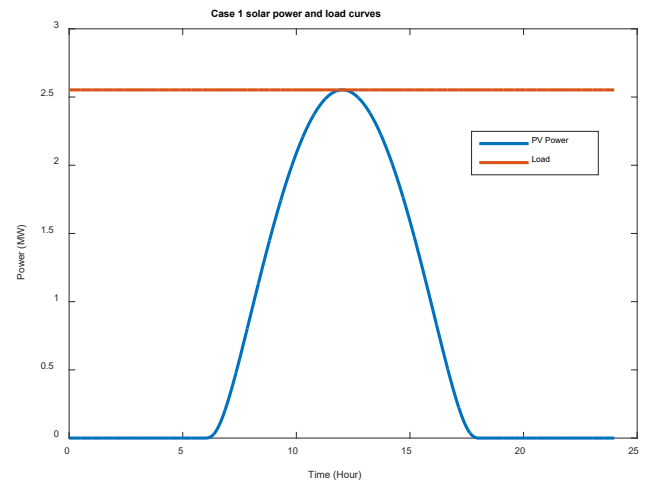


Figure 4: Solar and load curve for Case 1

801 The load power is assumed to be at the maximum
 802 point of the solar power curve for the default case. The
 803 LCOE for the default case is:

$$804 \text{ LCOE}_{\text{basecase}} = \frac{C_{\text{total_case1}}}{E_{\text{total_case1}}} = \frac{C_{\text{PVdirect}}}{E_{\text{PVdirect}}} \quad (30)$$

805 In Case 2, additional PV capacity is invested into the
 806 system. However, there is no storage device. Therefore,
 807 the surplus energy will be wasted. The shaded area is the
 808 extra solar energy produced in the system that consumed
 809 by the load compared to Case 1. Figure 5 shows the
 810 visual representation of Case 2. $E_{\text{total_case2}}$ is obtained
 811 by taking away E_{surplus} from the total energy production
 812 from PV, E_{PV2} due to no energy storage present in the
 813 system.

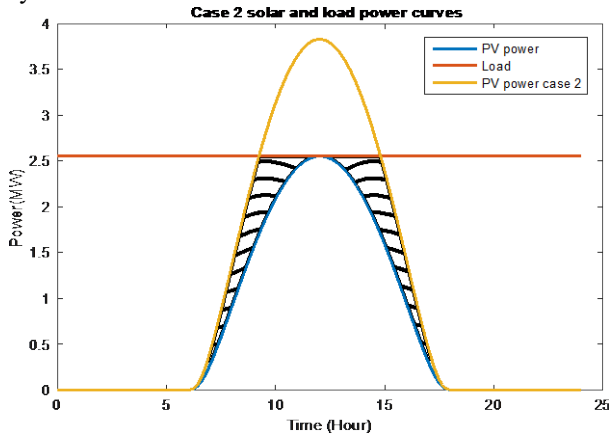


Figure 5: Solar and load curve for Case 2

816 The marginal LCOE from Case 1 to Case 2 is:

$$817 \text{ LCOE}_{\text{marginal}(1-2)} = \frac{\Delta C}{\Delta E} \\ 818 = \frac{C_{\text{total_case2}} - C_{\text{total_case1}}}{E_{\text{total_case2}} - E_{\text{total_case1}}} \quad (31)$$

819 where $E_{\text{total_case2}} = E_{\text{PV2}} - E_{\text{surplus}}$ (32)

820 In Case 3, further investment is put into the system as
 821 compared to Case 2 by including EES. The surplus
 822 energy will be stored in the EES and consumed by the
 823 load. Figure 6 shows the visual representation of Case 3.

824 The marginal LCOE from Case 2 to Case 3 is:

$$825 \text{ LCOE}_{\text{marginal}(2-3)} = \frac{\Delta C}{\Delta E} = \frac{C_{\text{total_case3}} - C_{\text{total_case2}}}{E_{\text{total_case3}} - E_{\text{total_case2}}} \\ 826 = \frac{(C_{\text{EES}} + C_{\text{total_case2}}) - C_{\text{total_case2}}}{E_{\text{total_case3}} - E_{\text{total_case2}}} = \frac{C_{\text{EES}}}{E_{\text{EES}}} \\ 827 = \text{LCOS} \quad (33)$$

828 The marginal LCOE from Case 2 to 3 can be deduced
 829 into LCOS as given in Equation (6).

830 A single combination investment of additional PV
 831 capacity and storage can be applied to Case 1. The
 832 marginal LCOE from Case 1 to Case 3 is provided in
 833 Equation (34).

834

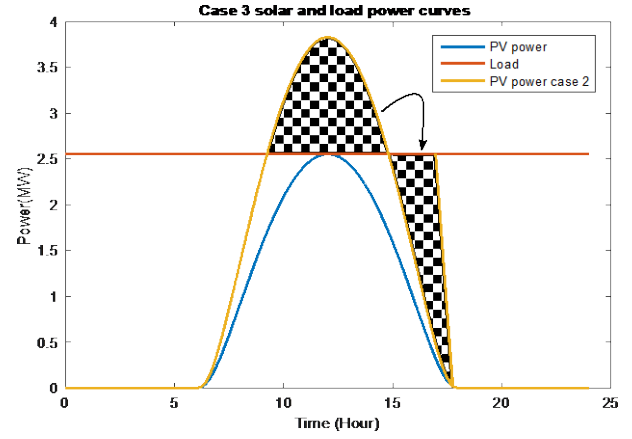


Figure 6: Solar and load curve for Case 3

$$835 \text{ LCOE}_{\text{marginal}(1-3)} = \frac{\Delta C}{\Delta E} \\ 836 = \frac{(C_{\text{total_case2}} - C_{\text{total_case1}}) + C_{\text{EES}}}{(E_{\text{total_case2}} - E_{\text{total_case1}}) + E_{\text{EES}}} \quad (34)$$

839 A sensitivity analysis has been conducted by varying
 840 the PV rated capacity. Case 1 consists of a solar farm
 841 with rated capacity of 2.5 MW, an arbitrary size used for
 842 the initial rated capacity of the solar farm. The calculated
 843 peak output power from the PV farm is 1.9 MW. As no
 844 surplus energy is available for case 1, the load curve will
 845 have a peak of 1.9 MW. This real-life load profile will
 846 be fixed throughout the sensitivity analysis for the study.
 847 The storage system used is VRB with storage capacity of
 848 3 MWh. The storage capacity is determined by
 849 calculating the maximum surplus power for the system.
 850 As reported in [66], the current discount rate for PV is 6-
 851 9%. The discount rate could be as much as 2-3% lower
 852 over the next decade, and could fall by a further 1-2% by
 853 2040. A discount rate at 5% is used to be in line with the
 854 best discount rate for PV systems in Kenya [59]. The
 855 resultant $\text{LCOE}_{\text{basecase}}$ for the system is \$0.093/kWh.
 856 The results from the sensitivity analysis on marginal
 857 LCOE, $\text{LCOE}_{\text{system}}$ and LCOD are presented in Figure 7.

858

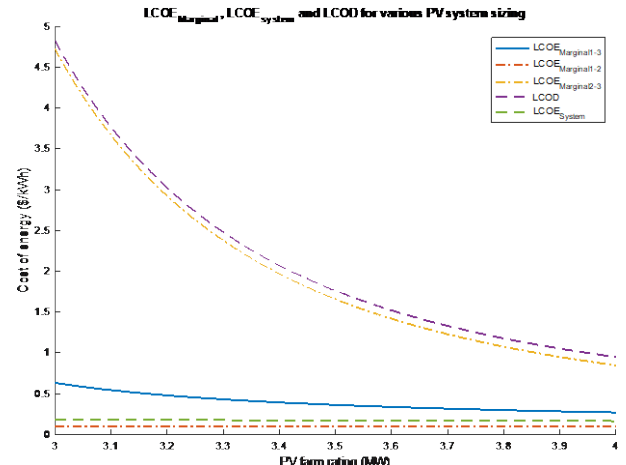


Figure 7: Marginal LCOE, LCOD and $\text{LCOE}_{\text{system}}$ with respect to PV capacity

862 It is noted that the value of $\text{LCOE}_{\text{system}}$ is different

from the total of $LCOE_{basecase}$ and $LCOE_{marginal(1-3)}$, as the summation of Equations (30) and (34) does not equal to Equation (27). The $LCOD$ and $LCOE_{marginal(2-3)}$ grows exponentially when the PV capacity is reduced. This is consistent with the $LCOS$ for pumped storage provided in [67], where the $LCOS$ will experience an exponential decrease with an increase in energy discharge from the storage system. This is due to the storage will store less energy with less surplus PV power. It is observed that the $LCOE_{marginal(2-3)}$ is less than $LCOD$, as $LCOD$ takes account of the cost for the fraction of solar array used to provide energy for the EES. $LCOE_{marginal(1-2)}$ experiences an increase as the PV capacity increases, due to the energy wastage for not utilizing the surplus energy. $LCOE_{system}$ will decrease with an increase in PV capacity as the energy is stored and utilized. $LCOE_{marginal(1-3)}$ is less than $LCOE_{marginal(2-3)}$ and $LCOD$ due to the inclusion of the additional PV capacity and surplus energy in system from Case 1 for non-storage. The $LCOE_{marginal(1-2)}$ is of higher value than the Lazard's result of $LCOS$ in Table 2. As explained previously, Lazard has made an assumption that the storage system is used at full capacity at all times. In a PV hybrid system, the storage system will seldom be used to the maximum and the energy depends on surplus power. The following phenomenon can be observed.

1. System without storage attracts a small $LCOE$ but naturally at a higher risk of security of supply and the marginal $LCOE$ will increase with the increase of PV capacity. This signifies the cost of system will increase with additional PV capacity.
2. $LCOD$ and $LCOE_{marginal(1-2)}$ can experience a decrease with the increase of PV capacity. The EES will deliver more energy as the surplus energy increases.
3. From investment point of view, it can be seen that it is important to add a battery as a component of the system rather than adding it in a later stage. The costs for separating the system can be high compared to considering the costs as a whole.

5.4. $LCOD$ and $LCOE_{system}$ for VRB and Li-ion battery

A scenario has been developed with the load and generation data from two African countries. The national load curve has been down-sized with the peak load at 2 MW to represent a load demand for a typical community in Africa. The rated capacity of the PV farm is 5 MW. The calculated capacity factor for the PV system are 12.02%, 11.67%, 12.26% and 12.61% for years 2009, 2010, 2011 and 2012 respectively. The purpose of this study is to calculate the $LCOE_{system}$ and $LCOD$ for a real-life renewable energy system with storage. $LCOE_{system}$ is the $LCOE$ for the combined assets, PV and EES. Two types of dominant EES technologies, Li-

ion and VRB are studied. In this study, three ranges of costs values are used to determine the cost of electricity for $LCOD$ and $LCOE_{system}$. These are lower bound, upper bound and the medium bound cost. The cost calculation is performed for each year of the four years of data. Sensitivity analysis is conducted for a range of discount rates. One of the vital input parameters for $LCOE$ calculations is the value of the discount rate. The discount rate essentially takes into account the time value of money, through monetary depreciation as well as the investments risks. PV systems are considered much higher risks when compared with traditional power plants, and therefore they will be at higher discount rates.

The results are summarized in a form of box plot in Figures 8 and 9. With a careful inspection in Figure 8, it can be seen that $LCOD$ is higher with Li-ion than VRB for both the median and minimum value when the discount rate is less than 8%. The discount rate needs to be 10% or more when $LCOD$ for VRB is higher than that for Li-ion.

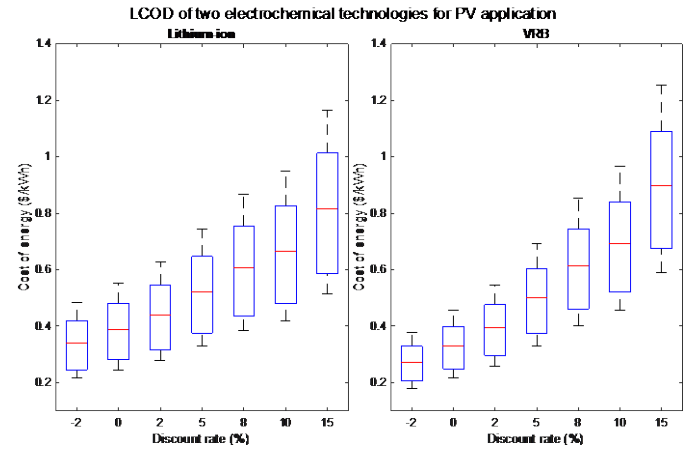


Figure 8: $LCOD$ for Li-ion and VRB at various discount rates

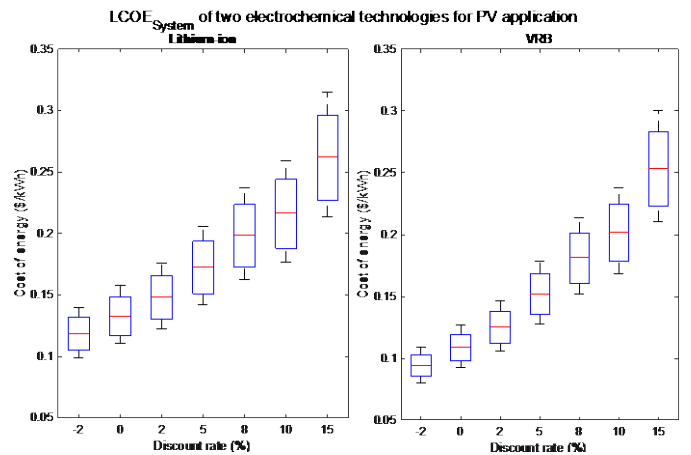


Figure 9: $LCOE_{system}$ for Li-ion and VRB at various discount rates

The results for $LCOE_{system}$ at various discount rates for the two EES technologies are given in Figure 9. Also with careful inspections, $LCOE$ is lower for VRB in all the studied discount rates and price range consideration.

Although Li-ion battery has a higher round-trip efficiency than VRB, the lifetime of the system is considerably shorter and this significantly affects the $LCOE_{system}$.

From Figures 8 and 9, it could be understood that adding EES to the system can increase the $LCOE_{system}$ at high discount rate. Also, the cost variation is wider. This is due to the capital and installation cost of the system being more dominant. At low discount rate, the value of energy will have less depreciation with respect to time.

6. Discussion

Successful operation of hybrid system requires continuous real-time balancing of supply and demand including losses. With the increasing amount of storage in the hybrid systems, it is crucial to analyze the economic values to determine the feasibility of such systems. The proposed methods could also be used to assess different EES technologies although in the paper, only VRB and Li-ion battery cases were given as examples. This method provides decision makers with a practical approach to consider the competitiveness of each technology for a given application with renewables in particular. From Figures 8 and 9, it can be seen that the results of LCOD and $LCOE_{system}$ are given in a range of values due to the uncertainty in the annual energy production from the PV system and the range of EES costs. Parameters such as round-trip efficiency, EES lifetime, discount rate have all been included in the studies and the functionality of the method has been shown with real-life data. It is noted that LCOS and LCOD will be higher than the $LCOE_{system}$.

For different types of EES, the state of charge will have a different impact on energy storage, as such the potential in using the battery fully will be different on each case. Therefore, the energy delivered and stored could affect the system performance as a whole, that is, the overall LCOE will be changed. State of charge and discharge and cycles could be considered in future work. This should also be studied even though energy balancing is not considered in the present paper.

Although the analyses show that the LCOD is cheaper for Li-ion than that for VRB at present, the $LCOE_{system}$ as a system could be lower for VRB compared to Li-ion. Since energy storage has many applications for power systems such as grid balancing and frequency regulation, the LCOS and LCOD will be significantly different due to the operating conditions of the EES. The future work would be to analyze the storage costs for different applications and services. With additional irradiance data, it will be possible to have a better determination of the cost in deployment of renewables system with integration of energy storage system. Table 5 presents the comparison of the technology and economic aspect

of the two EESs. At present, the capital and variable O&M costs are higher for Li-ion battery. The lifetime is generally higher for VRB compared to Li-ion battery. There is a significant difference in the round trip-efficiency for the two batteries, where Li-ion can reach up to 95% and VRB can reach 85% at the best. Table 6 provides a comparison of the pros and cons and the maturity of the EES technologies. It is learnt that thermal management is a major issue in using Li-ion battery for grid scale systems. VRB is currently the most mature technology for grid scale storage application and is currently available for commercial use [43, 68]. Additional sensitivity analysis will be a future work by considering the extremes of costs, lifetime and round-trip efficiency in order to provide a more accurate representation of the levelized costs for the two EESs.

Demand response based on dynamic pricing such as time-of-use (TOU) tariff can be used in conjunction with EES to increase the usefulness of surplus PV generation [69]. However, TOU are not normally used for PV systems due to its lack of dispatchability and imperfect predictability. There are companies offering energy storage options to Hawaii customers that own PV systems, in order for the state to meet 100% renewable energy goal [70]. The study of optimal use of tariff structures and EES dispatch techniques to reduce the PV system and EES levelized costs may be of future significant interests and research work needs to be done in this area.

The proposed LCOD and $LCOE_{system}$ were used for studying an optimal sized stand-alone PV and EES with Anaerobic digestion biogas power plants presented in [71]. The techno-economic study of a grid-connected hybrid system will be a future work.

Table 5

A review on technology and economics based information for VRB and Li-ion battery in grid scale application.

	VRB	Li-ion battery
Capital cost	460-1600 (\$/kWh) 600-1750 (\$/kW) [9, 44, 45, 63, 72-74]	500-2500 (\$/kWh) 900-3500 (\$/kW) [9, 44, 45, 63, 72-74]
O&M cost	Fixed: 3.6-18.3 (\$/kW-yr) Variable: 0.21-2.96 (\$/MWh) [9, 44, 63, 72]	Fixed: 2.12-14.5 (\$/kW-yr) Variable: 0.42-5.93 (\$/MWh) [9, 44, 63, 72]
Lifetime	10-20 years [9, 10, 44, 45, 63, 72-75]	5-15 years [9, 10, 44, 45, 63, 72-75]
Round-trip efficiency	75-85% [9, 10, 44, 45, 63, 72-75]	85-95% [9, 10, 44, 45, 63, 72-75]

Table 6

A review on commercial-socio based information for VRB and Li-ion battery in grid scale application.

	VRB	Li-ion
Advantages	<ul style="list-style-type: none"> • Power and energy ratings are independent and highly scalable • No degradation in energy storage capacity • High cycle life, up to 10,000 cycles • Capable to achieve very deep cycle, i.e. 100% depth of discharge 	<ul style="list-style-type: none"> • High energy and power density • Low self-discharge • High round-trip efficiency
Disadvantages	<ul style="list-style-type: none"> • High balance of system costs • Reduced efficiency due to rapid charge/discharge • Energy density and power density are generally lower compared to other EESs 	<ul style="list-style-type: none"> • High capital cost • Requires battery management system for operation, management and against cell degradation • Limited thermal tolerance • Thermal run away due to electrolyte decomposition
Commercial maturity	Demonstration/early commercialized	Demonstration
Technological maturity	Development phase	Development phase
References	[9, 10, 43-45, 63, 68, 72-78]	[9, 10, 43-45, 63, 72-75]

7. Conclusions

This paper has provided a review on LCOE for PV and PV hybrid systems. From the basic principles, the LCOD and the LCOE for PV systems with storage have been proposed. A more accurate calculation of LCOE for VRB and Li-ion battery, known as the LCOD, is given in this paper by taking the cost for energy generation into account. The long-term economic impact for storage and PV system is provided and discussed with marginal LCOE. The findings reveal that with the present costs and technical specification, VRB has a lower LCOD in relation to Li-ion at low discount rate for the energy storage application in PV systems.

References

- [1] D. G. Mears, H. Gotschall, and H. Kamath, "H. EPRI-DOE Handbook of Energy Storage for Transmission and Distribution Applications," *Electric Power Research Institute Report*, vol. 1001834, 2003.
- [2] IEEE Standards Association, "IEEE Guide for the Interoperability of Energy Storage Systems Integrated with the Electric Power Infrastructure, IEEE Std 2030.2TM-2015."
- [3] G. L. Kyriakopoulos, G. Arabatzis, and M. Chalikias, "Renewables exploitation for energy production and biomass use for electricity generation. A multi-parametric literature-based review," *AIMS Energy*, vol. 4, pp. 762-803, 2016.
- [4] D. Lineweber and S. McNulty, "The cost of power disturbances to industrial & digital economy companies," *Madison, WI: Primen*, 2001.
- [5] W.-P. Schill, "Residual load, renewable surplus generation and storage requirements in Germany," *Energy Policy*, vol. 73, pp. 65-79, 2014.
- [6] N. S. Wade, P. Taylor, P. Lang, and P. Jones, "Evaluating the benefits of an electrical energy storage system in a future smart grid," *Energy policy*, vol. 38, pp. 7180-7188, 2010.
- [7] P. Denholm and M. Hand, "Grid flexibility and storage required to achieve very high penetration of variable renewable electricity," *Energy Policy*, vol. 39, pp. 1817-1830, 2011.
- [8] P. Poonpun and W. T. Jewell, "Analysis of the cost per kilowatt hour to store electricity," *IEEE Transactions on Energy Conversion*, vol. 23, pp. 529-534, 2008.
- [9] B. Zakeri and S. Syri, "Electrical energy storage systems: A comparative life cycle cost analysis," *Renewable and Sustainable Energy Reviews*, vol. 42, pp. 569-596, 2015.

- [10] J. Leadbetter and L. G. Swan, "Selection of battery technology to support grid-integrated renewable electricity," *Journal of Power Sources*, vol. 216, pp. 376-386, 2012.
- [11] N. Singh and E. W. McFarland, "Levelized cost of energy and sensitivity analysis for the hydrogen-bromine flow battery," *Journal of Power Sources*, vol. 288, pp. 187-198, 2015.
- [12] G. Díaz, J. Gómez-Aleixandre, and J. Coto, "Dynamic evaluation of the levelized cost of wind power generation," *Energy Conversion and Management*, vol. 101, pp. 721-729, 2015.
- [13] S. B. Darling, F. You, T. Veselka, and A. Velosa, "Assumptions and the levelized cost of energy for photovoltaics," *Energy & Environmental Science*, vol. 4, pp. 3133-3139, 2011.
- [14] M. Jakob, "Energy policy: The fair cost of renewable energy," *Nature Climate Change*, vol. 2, pp. 488-489, 2012.
- [15] G. Allan, M. Gilmartin, P. McGregor, and K. Swales, "Levelised costs of Wave and Tidal energy in the UK: Cost competitiveness and the importance of "banded" Renewables Obligation Certificates," *Energy Policy*, vol. 39, pp. 23-39, 2011.
- [16] K. Branker, M. Pathak, and J. M. Pearce, "A review of solar photovoltaic levelized cost of electricity," *Renewable and Sustainable Energy Reviews*, vol. 15, pp. 4470-4482, 2011.
- [17] S. Mandelli, C. Brivio, E. Colombo, and M. Merlo, "A sizing methodology based on Levelized Cost of Supplied and Lost Energy for off-grid rural electrification systems," *Renewable Energy*, vol. 89, pp. 475-488, 2016.
- [18] M. Peters, T. S. Schmidt, D. Wiederkehr, and M. Schneider, "Shedding light on solar technologies—a techno-economic assessment and its policy implications," *Energy Policy*, vol. 39, pp. 6422-6439, 2011.
- [19] S. Reichelstein and M. Yorston, "The prospects for cost competitive solar PV power," *Energy Policy*, vol. 55, pp. 117-127, 2013.
- [20] A. Orioli and A. Di Gangi, "The recent change in the Italian policies for photovoltaics: Effects on the payback period and levelized cost of electricity of grid-connected photovoltaic systems installed in urban contexts," *Energy*, vol. 93, pp. 1989-2005, 2015.
- [21] X. Wang, L. Kurdgelashvili, J. Byrne, and A. Barnett, "The value of module efficiency in lowering the levelized cost of energy of photovoltaic systems," *Renewable and Sustainable Energy Reviews*, vol. 15, pp. 4248-4254, 2011.
- [22] J. Ondraczek, N. Komendantova, and A. Patt, "WACC the dog: The effect of financing costs on the levelized cost of solar PV power," *Renewable Energy*, vol. 75, pp. 888-898, 2015.
- [23] J. Hernández-Moro and J. Martínez-Duart, "Analytical model for solar PV and CSP electricity costs: Present LCOE values and their future evolution," *Renewable and Sustainable Energy Reviews*, vol. 20, pp. 119-132, 2013.
- [24] M. H. Kang and A. Rohatgi, "Quantitative analysis of the levelized cost of electricity of commercial scale photovoltaics

- systems in the US," *Solar Energy Materials and Solar Cells*, vol. 154, pp. 71-77, 2016.
- [25] M. Said, M. EL-Shimy, and M. Abdelraheem, "Photovoltaics energy: Improved modeling and analysis of the levelized cost of energy (LCOE) and grid parity-Egypt case study," *Sustainable Energy Technologies and Assessments*, vol. 9, pp. 37-48, 2015.
- [26] System Advisor Model (SAM), National Renewable Energy Laboratory, [Online]. Available: <https://sam.nrel.gov/>. [accessed 29.11.16].
- [27] C. Li and W. Yu, "Techno-economic comparative analysis of off-grid hybrid photovoltaic/diesel/battery and photovoltaic/battery power systems for a household in Urumqi, China," *Journal of Cleaner Production*, vol. 124, pp. 258-265, 2016.
- [28] S. Rehman, M. A. Bader, and S. A. Al-Moallem, "Cost of solar energy generated using PV panels," *Renewable and Sustainable Energy Reviews*, vol. 11, pp. 1843-1857, 2007.
- [29] RETScreen, Natural Resources Canada, [Online]. Available: <http://www.nrcan.gc.ca/energy/software-tools/7465>. [accessed 29.11.16].
- [30] G. Liu, M. Rasul, M. Amanullah, and M. M. K. Khan, "Techno-economic simulation and optimization of residential grid-connected PV system for the Queensland climate," *Renewable Energy*, vol. 45, pp. 146-155, 2012.
- [31] S. Rehman and L. M. Al-Hadhrani, "Study of a solar PV-diesel-battery hybrid power system for a remotely located population near Rafha, Saudi Arabia," *Energy*, vol. 35, pp. 4986-4995, 2010.
- [32] Homer Energy, [Online]. Available: <http://www.homerenergy.com/software.html>. [accessed 29.11.16].
- [33] O. Erdinc and M. Uzunoglu, "Optimum design of hybrid renewable energy systems: Overview of different approaches," *Renewable and Sustainable Energy Reviews*, vol. 16, pp. 1412-1425, 2012.
- [34] Z. Wissem, K. Gueorgui, and K. Hédi, "Modeling and technical-economic optimization of an autonomous photovoltaic system," *Energy*, vol. 37, pp. 263-272, 2012.
- [35] A. Ghafoor and A. Munir, "Design and economics analysis of an off-grid PV system for household electrification," *Renewable and Sustainable Energy Reviews*, vol. 42, pp. 496-502, 2015.
- [36] J. Hoppmann, J. Volland, T. S. Schmidt, and V. H. Hoffmann, "The economic viability of battery storage for residential solar photovoltaic systems-A review and a simulation model," *Renewable and Sustainable Energy Reviews*, vol. 39, pp. 1101-1118, 2014.
- [37] C. Parrado, A. Girard, F. Simon, and E. Fuentealba, "2050 LCOE (Levelized Cost of Energy) projection for a hybrid PV (photovoltaic)-CSP (concentrated solar power) plant in the Atacama Desert, Chile," *Energy*, vol. 94, pp. 422-430, 2016.
- [38] M. Bortolini, M. Gamberi, and A. Graziani, "Technical and economic design of photovoltaic and battery energy storage system," *Energy Conversion and Management*, vol. 86, pp. 81-92, 2014.
- [39] X. Ouyang and B. Lin, "Levelized cost of electricity (LCOE) of renewable energies and required subsidies in China," *Energy policy*, vol. 70, pp. 64-73, 2014.
- [40] S. D. Garvey, P. Eames, J. Wang, A. Pimm, M. Waterson, R. MacKay, et al., "On generation-integrated energy storage," *Energy Policy*, vol. 86, pp. 544-551, 2015.
- [41] A. Gómez, C. Dopazo, and N. Fueyo, "The 'cost of not doing' energy planning: The Spanish energy bubble," *Energy*, vol. 101, pp. 434-446, 2016.
- [42] A. Colmenar-Santos, S. Campiñez-Romero, C. Pérez-Molina, and M. Castro-Gil, "Profitability analysis of grid-connected photovoltaic facilities for household electricity self-sufficiency," *Energy Policy*, vol. 51, pp. 749-764, 2012.
- [43] Kathie Zipp, "What is the best type of battery for solar storage?", *Solar Power World*, 2015, [Online]. Available: <http://www.solarpowerworldonline.com/2015/08/what-is-the-best-type-of-battery-for-solar-storage/>. [accessed 29.11.16].
- [44] World Energy Resources, "E-storage: Shifting from cost to value Wind and solar applications," World Energy Council, 2016.
- [45] Lazard, "Lazard's Levelized Cost of Storage Analysis V1.0," [Online]. Available: <https://www.lazard.com/media/2391/lazards-levelized-cost-of-storage-analysis-10.pdf> [accessed 29.11.16].
- [46] I. Pawel, "The cost of storage-How to calculate the Levelized Cost of stored Energy (LCOE) and applications to renewable energy generation," *Energy Procedia*, vol. 46, pp. 68-77, 2014.
- [47] A. S. Mundada, K. K. Shah, and J. Pearce, "Levelized cost of electricity for solar photovoltaic, battery and cogen hybrid systems," *Renewable and Sustainable Energy Reviews*, vol. 57, pp. 692-703, 2016.
- [48] M. Obi, S. Jensen, J. B. Ferris, and R. B. Bass, "Calculation of levelized costs of electricity for various electrical energy storage systems," *Renewable and Sustainable Energy Reviews*, vol. 67, pp. 908-920, 2017.
- [49] "HOMER Pro version 3.7 user manual," HOMER Energy, Aug. 2016. [Online]. Available: <http://www.homerenergy.com/pdf/HOMERHelpManual.pdf> [accessed 29.11.16].
- [50] "RETScreen software online user manual: Combined heat and power project model," RETScreen International, Natural Resources Canada. [Online]. Available: [http://www.mcit.gov.cy/mcit/mcit.nsf/0/EF620C37922EDAEC22575CB00457F21/\\$file/Retscreen Manual \(CHP\).pdf](http://www.mcit.gov.cy/mcit/mcit.nsf/0/EF620C37922EDAEC22575CB00457F21/$file/Retscreen%20Manual%20(CHP).pdf) [accessed 29.11.16].
- [51] "User manual: SAM Version 2016.3.14 " System Advisor Model, National Renewable Energy Laboratory, Sept. 2016. [Online]. Available: <https://sam.nrel.gov/download> (Visited on 29th Nov. 2016).
- [52] N. DiOrio, "System Advisor Model battery storage," System Advisor Model, National Renewable Energy Laboratory, 2015. [Online]. Available: <https://sam.nrel.gov/node/69635> [accessed 29.11.16].
- [53] W. Short, D. J. Packey, and T. Holt, *A manual for the economic evaluation of energy efficiency and renewable energy technologies*: University Press of the Pacific, 2005.
- [54] Skye Instruments Ltd, "SKS 1110 Pyranometer," [Online]. Available: http://www.skyeinstruments.info/index_htm_files/Pyranometer.pdf [accessed 29.11.16].
- [55] G. Kidegho and M. Mbogho, "A study of an urban domestic composite load model suitable for solar PV and grid hybrid system," in *Scientific Conference Proceedings*, 2010. [Online]. Available: <http://journals.jkuat.ac.ke/index.php/jscsp/article/view/701> [accessed 29.11.16].
- [56] National Energy Regulator of South Africa, "2006 Electricity supply statistics for South Africa," [Online]. Available: [http://www.nersa.org.za/Admin/Document/Editor/file/News and Publications/Publications/Current Issues/Electricity Supply Statistics/Electricity supply statistics 2006.pdf](http://www.nersa.org.za/Admin/Document/Editor/file/News%20and%20Publications/Publications/Current%20Issues/Electricity%20Supply%20Statistics/Electricity%20supply%20statistics%202006.pdf) [accessed 29.11.16].
- [57] National Electricity Regulator, "Electricity supply statistics 2001 for South Africa," [Online]. Available: [http://www.nersa.org.za/Admin/Document/Editor/file/News and Publications/Publications/Archived Issues/Electricity Supply Statistics/ESS2001_o.pdf](http://www.nersa.org.za/Admin/Document/Editor/file/News%20and%20Publications/Publications/Archived%20Issues/Electricity%20Supply%20Statistics/ESS2001_o.pdf) [accessed 29.11.16].
- [58] A. Rose, R. Stoner, and I. Pérez-Arriaga, "Prospects for grid-connected solar PV in Kenya: A systems approach," *Applied Energy*, vol. 161, pp. 583-590, 2016.
- [59] J. Ondraczek, "Are we there yet? Improving solar PV economics and power planning in developing countries: The case of Kenya," *Renewable and Sustainable Energy Reviews*, vol. 30, pp. 604-615, 2014.
- [60] A. Hassan, M. Saadawi, M. Kandil, and M. Saeed, "Modified particle swarm optimisation technique for optimal design of small renewable energy system supplying a specific load at Mansoura University," *IET Renewable Power Generation*, vol. 9, pp. 474-483, 2015.
- [61] R. Dufo-López, E. Pérez-Cebollada, J. L. Bernal-Agustín, and I. Martínez-Ruiz, "Optimisation of energy supply at off-grid healthcare facilities using Monte Carlo simulation," *Energy Conversion and Management*, vol. 113, pp. 321-330, 2016.

- [62] R. M. Swanson, "A vision for crystalline silicon photovoltaics," *Progress in photovoltaics: Research and Applications*, vol. 14, pp. 443-453, 2006.
- [63] X. Luo, J. Wang, M. Dooner, and J. Clarke, "Overview of current development in electrical energy storage technologies and the application potential in power system operation," *Applied Energy*, vol. 137, pp. 511-536, 2015.
- [64] Z. Moradi-Shahrabak, A. Tabesh, and G. R. Yousefi, "Economical design of utility-scale photovoltaic power plants with optimum availability," *IEEE Transactions on Industrial Electronics*, vol. 61, pp. 3399-3406, 2014.
- [65] National Renewable Energy Laboratory (NREL), "CREST Cost of Energy Model: Photovoltaic V1.4," [Online]. Available: <https://financere.nrel.gov/finance/content/crest-cost-energy-models> [accessed 29.11.16].
- [66] Prepared for the committee on climate change, "Discount rates for low-carbon and renewable generation technologies," Oxera, [Online]. Available: <http://www.oxera.com/Latest-Thinking/Publications/Reports/2011/Discount-rates-for-low-carbon-and-renewable-genera.aspx> [accessed 29.11.16].
- [67] V. Jülch, "Comparison of electricity storage options using levelized cost of storage (LCOS) method," *Applied Energy*, vol. 183, pp. 1594-1606, 2016.
- [68] "UET UniSystem Product Sheet, "UNISYSTEM™ grid-scale energy storage system", uetechnologies," [Online]. Available: http://www.uettechnologies.com/images/product/UET_UniSystem_ProductSheet.pdf [accessed 29.11.16].
- [69] P. Denholm and R. M. Margolis, "Evaluating the limits of solar photovoltaics (PV) in electric power systems utilizing energy storage and other enabling technologies," *Energy Policy*, vol. 35, pp. 4424-4433, 2007.
- [70] Kathryn Mykleseth, "Battery Storage Companies Flock To Hawaii," govtech.com, Nov. 2015. [Online]. Available: <http://www.govtech.com/fs/Battery-Storage-Companies-Flock-To-Hawaii.html> [accessed 29.11.16].
- [71] C. S. Lai and M. D. McCulloch, "Sizing of stand-alone solar PV and storage system with Anaerobic digestion biogas power plants," *IEEE Transactions on Industrial Electronics*, Oct. 2016, DOI 10.1109/TIE.2016.2625781.
- [72] F. Díaz-González, A. Sumper, F. D'Áz-González, and O. Gomis-Bellmunt, *Energy Storage in Power Systems*: John Wiley & Sons, 2016.
- [73] "Energy storage: Tracking the technologies that will transform the power sector," Deloitte, 2015. [Online]. Available: <http://www2.deloitte.com/content/dam/Deloitte/us/Documents/energy-resources/us-er-energy-storage-tracking-technologies-transform-power-sector.pdf> [accessed 29.11.16].
- [74] G. L. Kyriakopoulos and G. Arbatzis, "Electrical energy storage systems in electricity generation: energy policies, innovative technologies, and regulatory regimes," *Renewable and Sustainable Energy Reviews*, vol. 56, pp. 1044-1067, 2016.
- [75] G. Locatelli, E. Palmera, and M. Mancini, "Assessing the economics of large Energy Storage Plants with an optimisation methodology," *Energy*, vol. 83, pp. 15-28, 2015.
- [76] L. Sanz, D. Lloyd, E. Magdalena, J. Palma, and K. Kontturi, "Description and performance of a novel aqueous all-copper redox flow battery," *Journal of Power Sources*, vol. 268, pp. 121-128, 2014.
- [77] P. Alotto, M. Guarnieri, and F. Moro, "Redox flow batteries for the storage of renewable energy: A review," *Renewable and Sustainable Energy Reviews*, vol. 29, pp. 325-335, 2014.
- [78] "Eric Wesoff, Jeff St. John, "Largest Capacity Flow Battery in North America and EU Is On-Line and Commissioned", greentechmedia, June 19, 2015," [Online]. Available: <http://www.greentechmedia.com/articles/read/Largest-Capacity-Flow-Battery-in-North-America-and-EU-is-Online-and-Commiss> [accessed 29.11.16].